(10) 1" WIDE 2'-6" LONG SLOT DIFFUSERS EACH AT 100 CFM
TYPICAL FOR ALL 40'-0" LONG NORTH PERIMETER BAYS

SEE HVAC-12 FOR VESTIBULE SYSTEM

FOR MECHANICAL EQUIPMENT ROOM LAYOUT SEE DWG. HVAC-12

FOR CONTINUATION SEE DWG. HVAC-7

INDICATES STEEL OPENING (TYP.)

SEE TYPICAL DUCT LAYOUT BETWEEN COLUMN 17 & 19

BCD'S (160) EACH

(10) 1" WIDE 2'-6" LONG SLOT DIFFUSERS EACH AT 100 C.F.M
TYPICAL FOR ALL 40'-0" SOUTH PERIMETER BAYS

1" SLOT BY ARCHT.

NOTE:
1. LINEAR SLOT DIFFUSER IN ELEVATOR LOBBY SHALL HAVE A BRUSHED MIRROR FINISH.

CONTINUOUS 1 SLOT LINEAR DIFFUSER APPROX. 180'-0" LONG TO MATCH ARCHITECTURAL DWG'S. 16'-0" ACTIVE 15 SUPPLY (30) CFM/LF PLENUM 7'x7' TAPE 10 LF VALVED MOTION USED AS RETURN

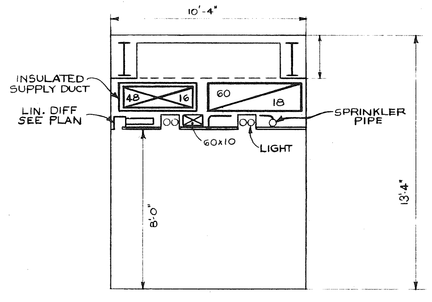

SECTION A-A'
SCALE 1/4"=1'-0"

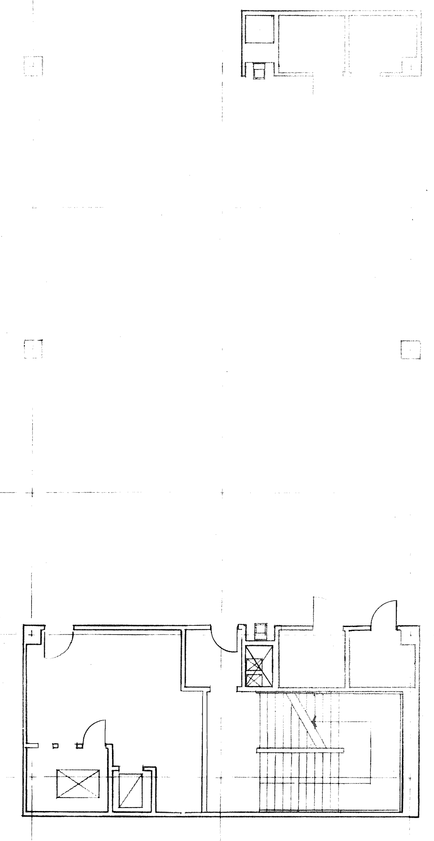

Norwalk
Building 43

Norwalk, California

Skidmore, Owings & Merrill
Architects/Engineers
One Maritime Plaza
San Francisco, California

Jaros, Baum & Bolles
Consulting Engineers
345 Park Avenue
New York, New York

Approved for the Owner by

Approved for the Architect by

Drawn by | Job Number

Checked by | Date

Revisions

No.	Revisions indicated thus △1	Date
	ISSUED FOR BID	12/15/81
1	[illegible]	4-3-82
2	ADDENDUM NO 44 REISSUED FOR BLDG. DEPT.	
3	ADDENDUM #71 REVISED AS PER BUILDING COMMENTS	8/24/82

BECHTEL JOB NO. 6157 (5700)

M.E. 12658

KEY PLAN

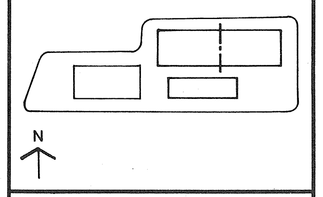

N

LEVELS 3 THROUGH 7
TYPICAL FLOOR
PLAN EAST

SCALE: 1/8"=1'-0"

HVAC-6

215.44