

Norwalk
Building 43

Norwalk, California


Sklomore, Owings & Merrill
Architects/Engineers
One Maritime Plaza
San Francisco, California

Jaros, Baum & Bolles
Consulting Engineers
3000 California Street
New York, New York

Approved by the Owner	
Approved by the Architect	
Drawn by	Job Number
Checked by	Date
Revisions	
No.	Revisions Indicated there Δ:
ISSUED FOR BIDDING	7/15/81

PIPE DIAMETER GREATER THAN	U-BOLT ROD DIAH
2"	1/4" MIN.
3"	3/8"
4"	1/2"
6"	5/8"
8"	3/4"
10"	7/8"
12"	1"


NOTE:
PROVIDE 1" OPERATING
CLEARANCE (MINIMUM) IF
PIPES ARE RESILIENTLY
MOUNTED.

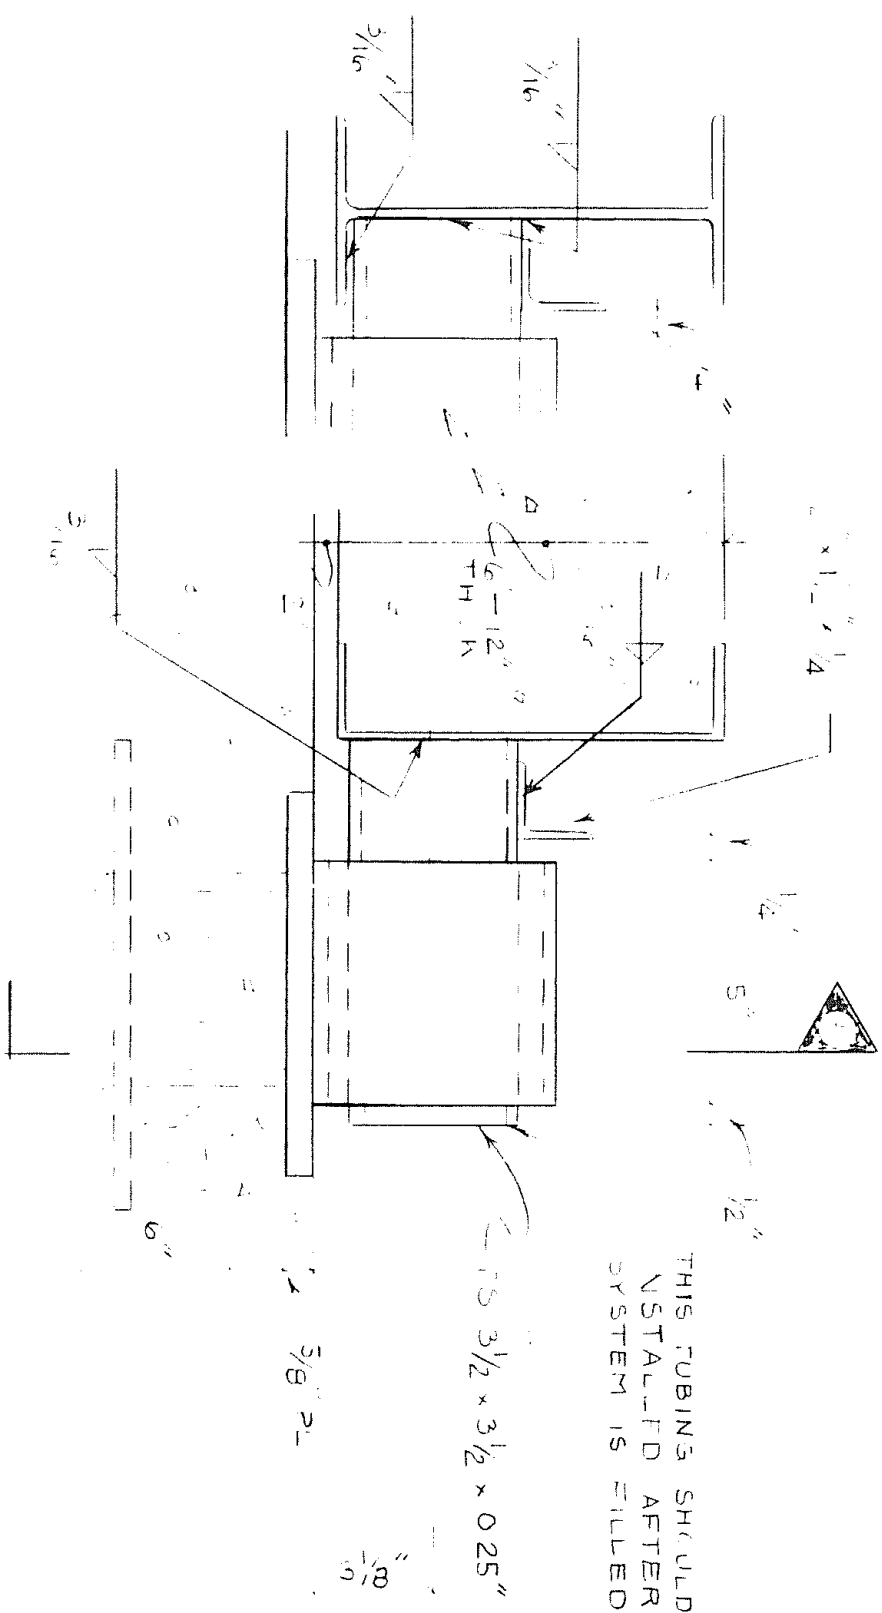

SECTION - A



- NOTES:
- 1) MIN. 4 HESTRAEM™ PER EQUIPMENT.
 - 2) FOR EQUIPMENT WEIGHTS TO 2000 LBS, USE 1/2" HESTRAEM™.
 - 3) FOR EQUIPMENT WEIGHTS TO 4000 LBS, USE 3/4" HESTRAEM™.

TYPE C - FLOOR SUPPORTED CENTRIFUGAL FANS, PUMPS AND CONTROL AIR COMPRESSOR

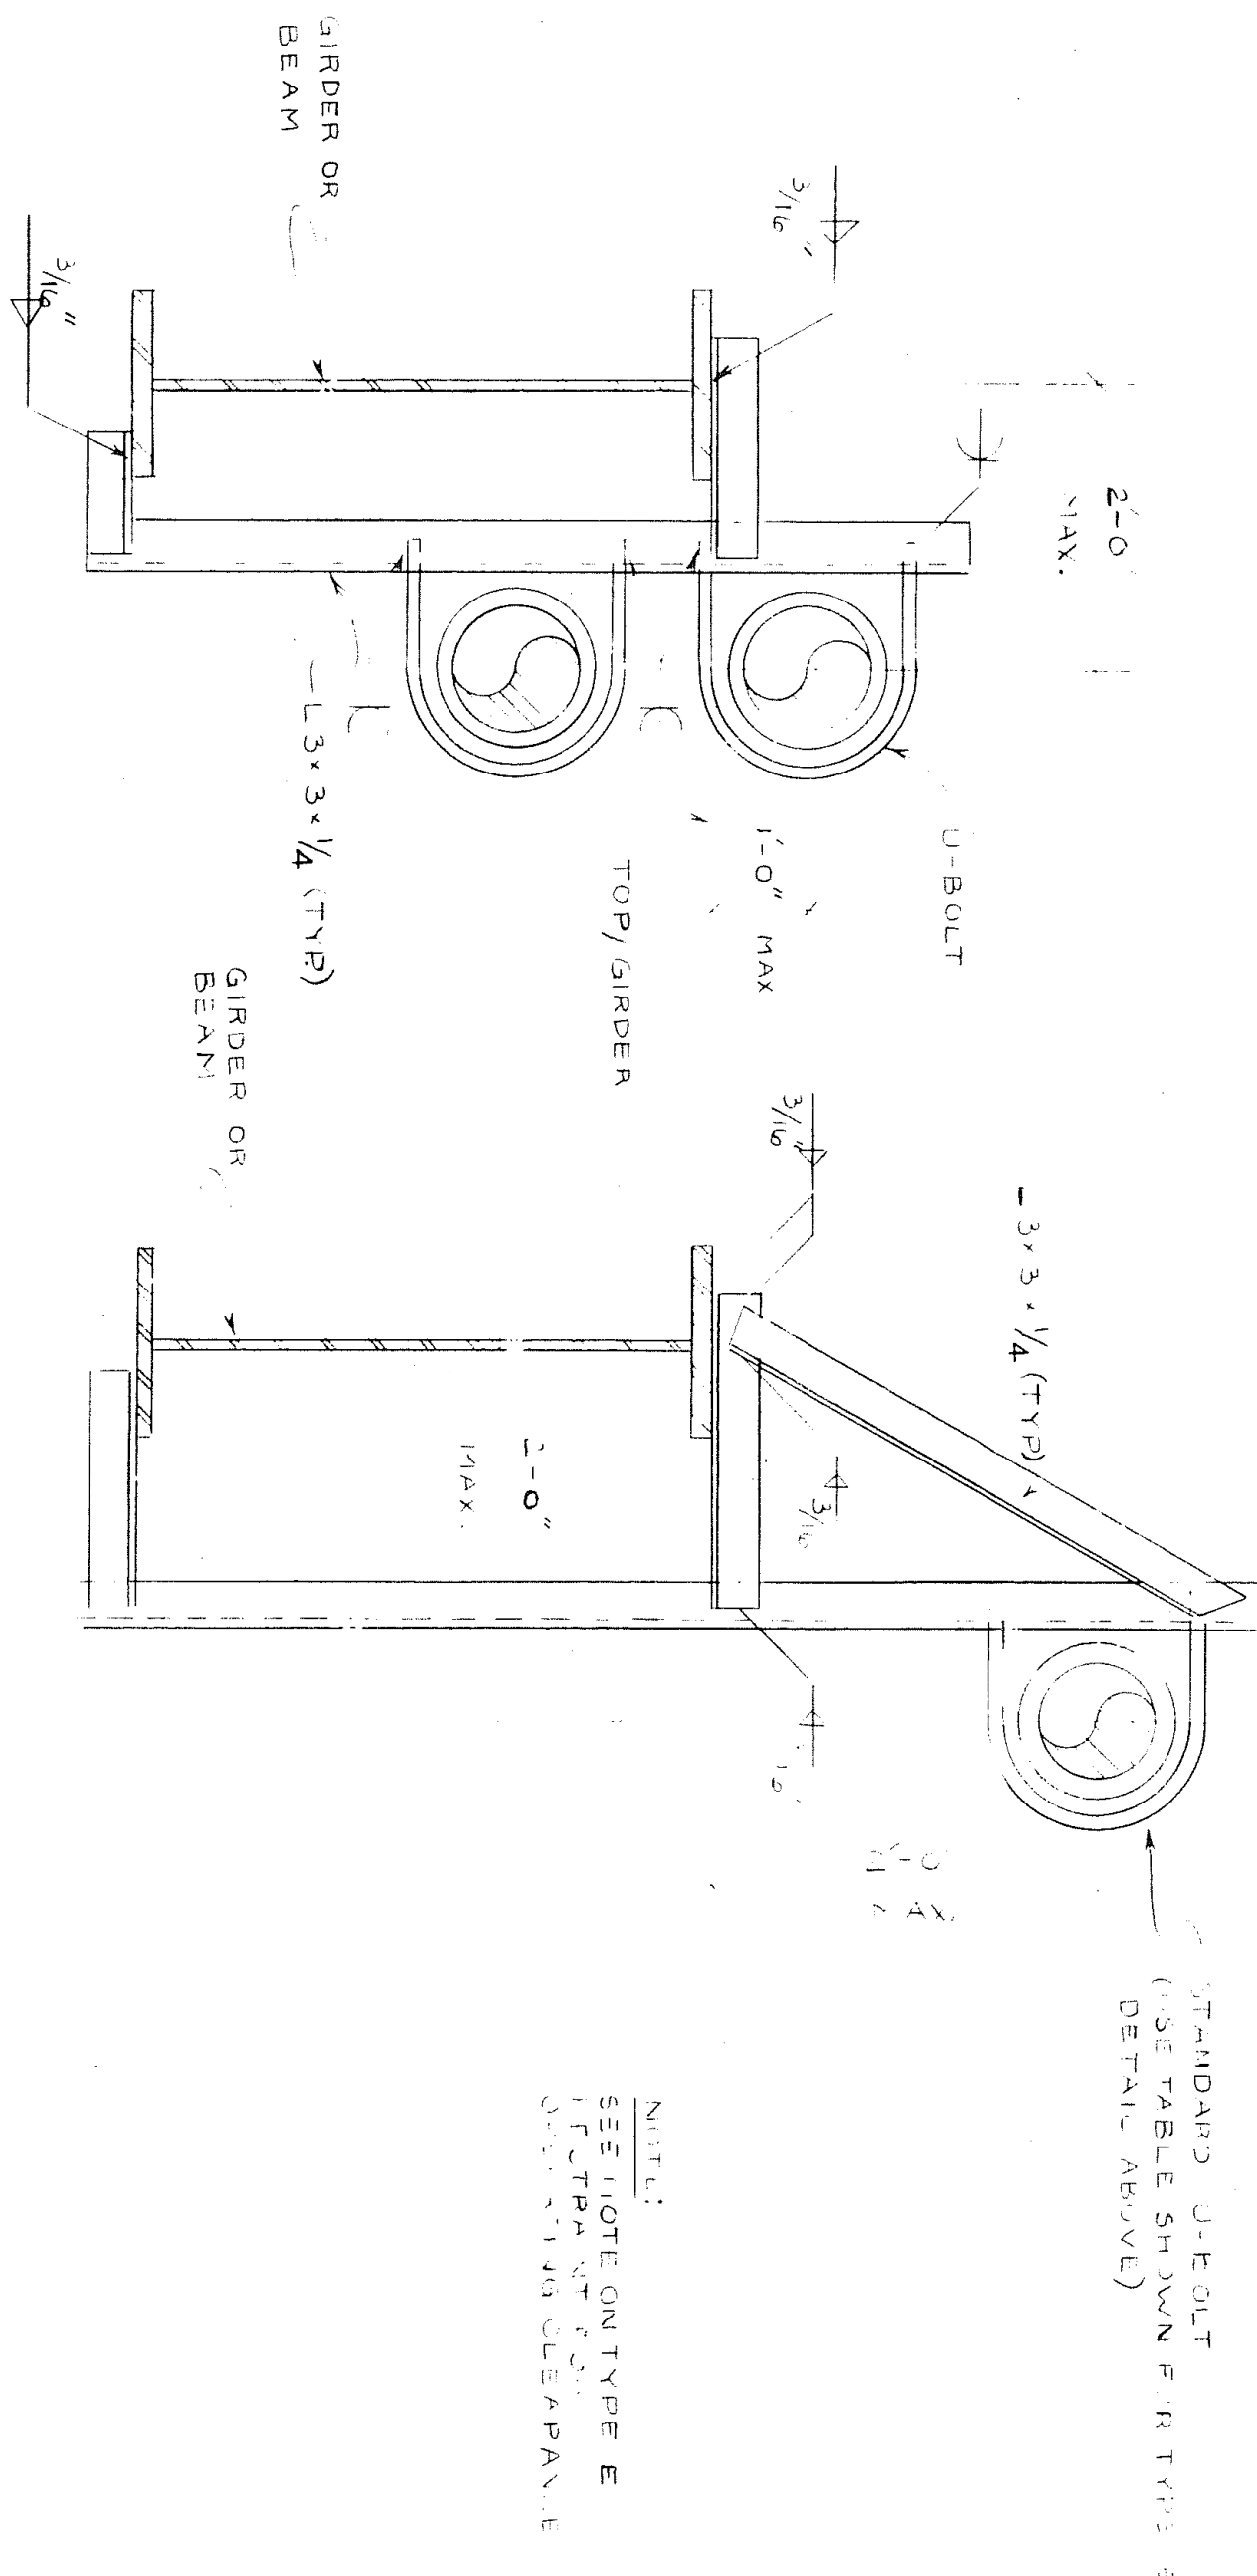

TYPE F - BRACKET TYPE FOR PIPING

TYPE D - HANGER TYPE FOR PIPING DIAM. ≥ 8"

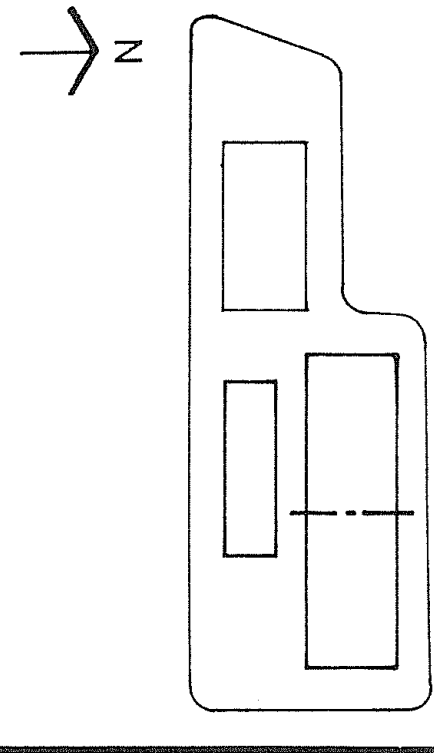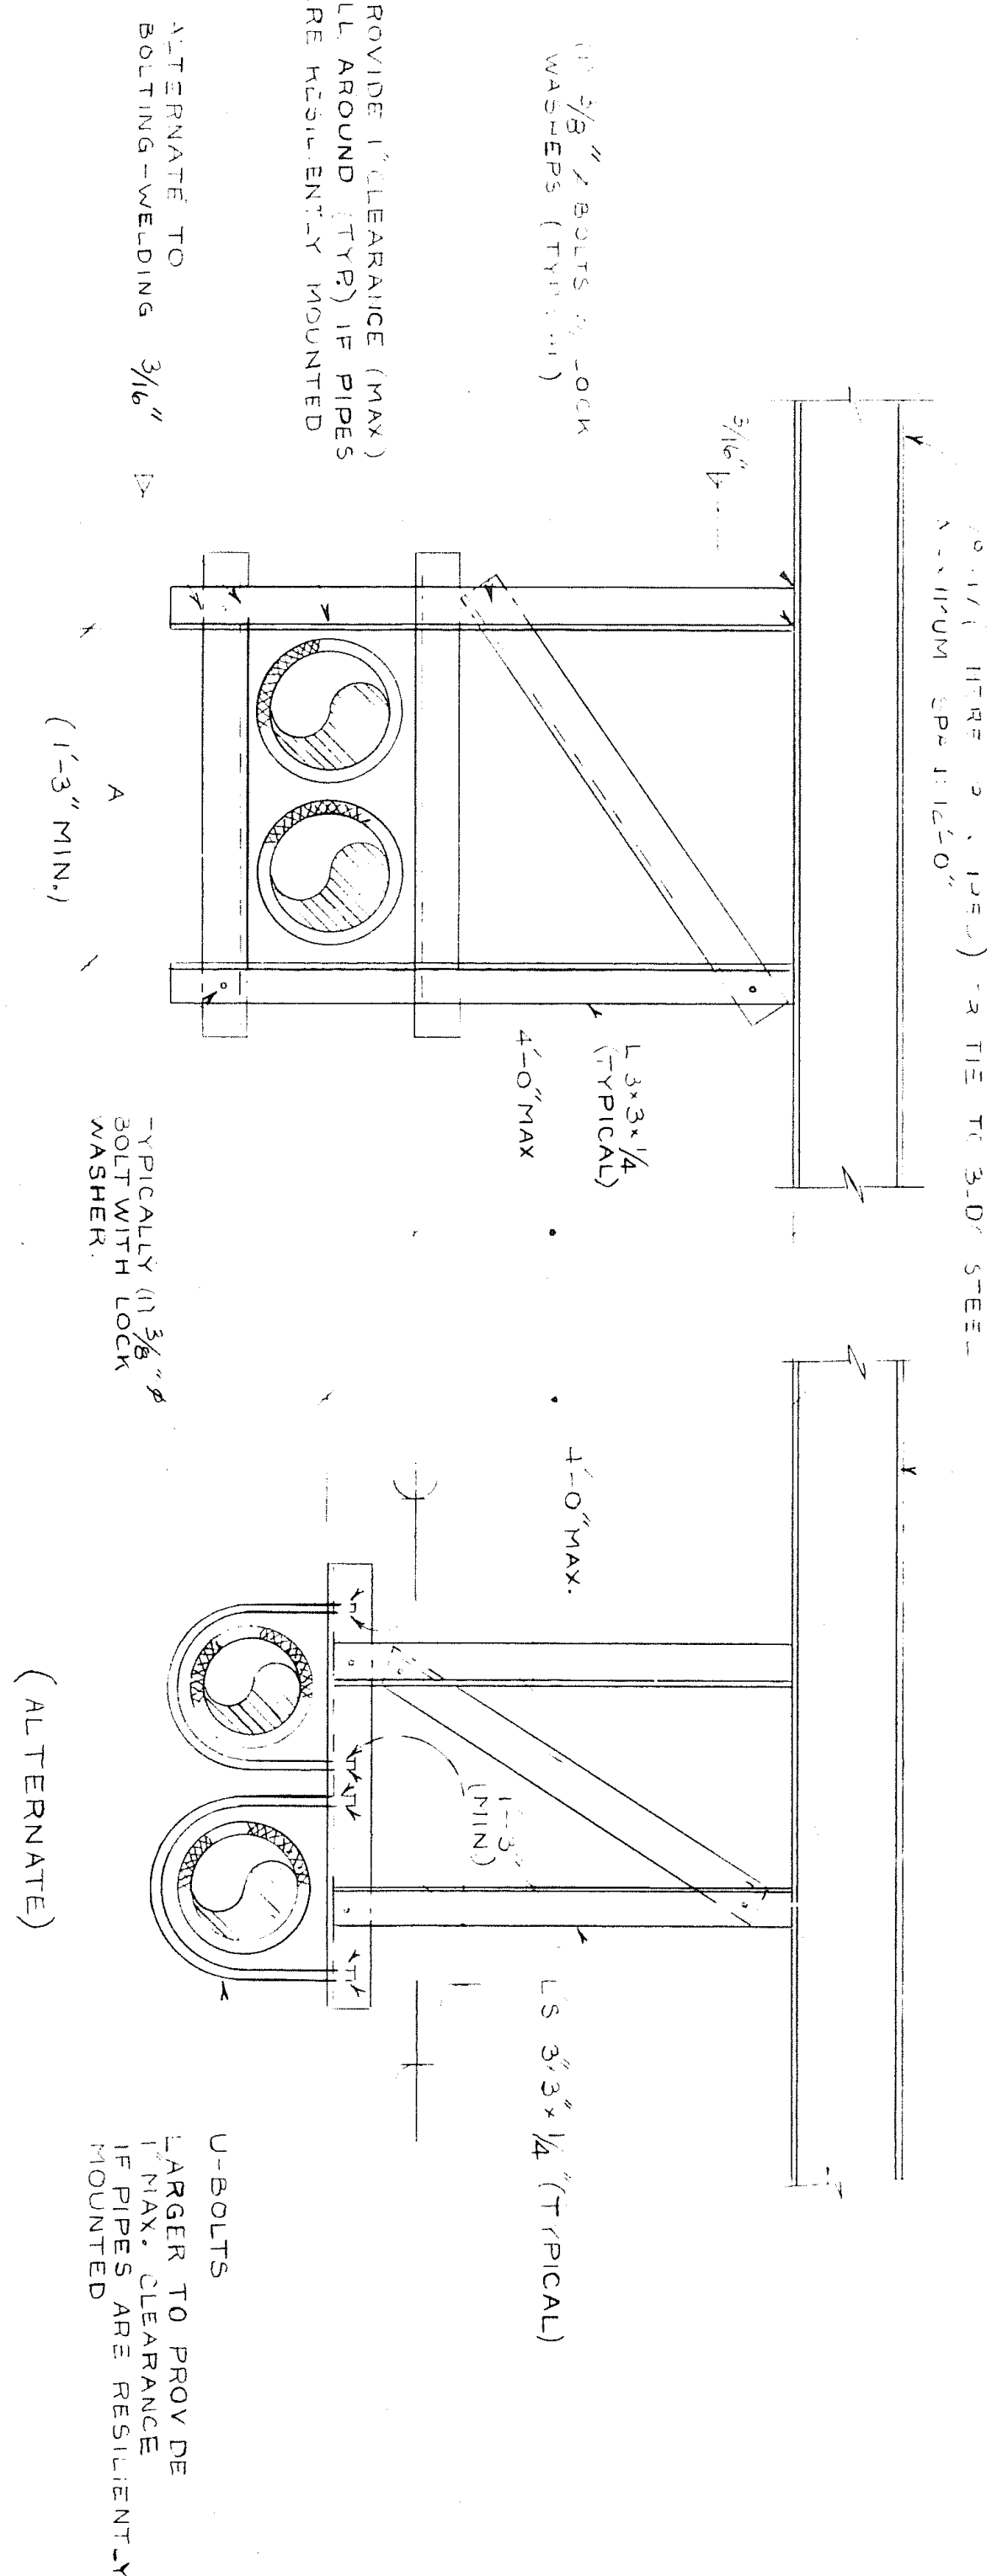

DETAIL SHEET NO.3

SCALE: NONE

HVAC-22